


NOTE: ALL PROGRAMMABLE/ADDRESSABLE DEVICES SHALL BE PROGRAMMED BY OTHERS.

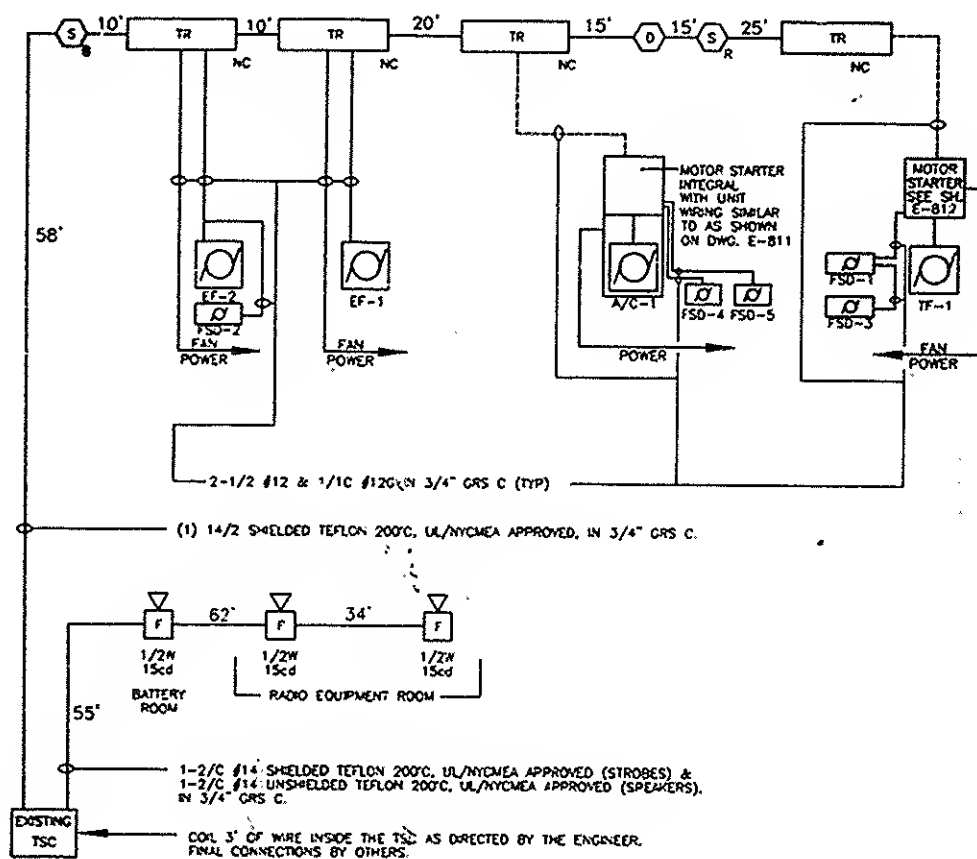

SEQUENCE OF OPERATION


- ANY DETECTOR OPERATION (ALARM) SHUTS DOWN ALL FANS (EF-1, EF-2, TF-1, AND A/C-1) AND CLOSES ALL FIRE SMOKE DAMPERS FSD-1 THROUGH FSD-5 VIA TR ADDRESSABLE INTERFACES.
- ALL EVENTS REPORT TO BASE BUILDING FIRE ALARM SYSTEM VIA DIRECT CONNECTION (FROM EXISTING TSC (1)B4ET).

FIRE ALARM SYSTEM RISER DIAGRAM (NOT TO SCALE)

NOTE: ALL CIRCUIT LENGTHS ARE APPROXIMATE.

STROBE CIRCUIT	TYPE STROBE	# STROBES/CIRCUIT	CURRENT EA @ 24VDC	TOTAL CURRENT/ STROBE CIRCUIT
NUMBER 1	1S	3	0.063A	0.189A

SPEAKER CIRCUIT	WATTAGE TAP	QUANTITY	TOTAL WATTS
NUMBER 1	1/2 W	3	1 1/2W

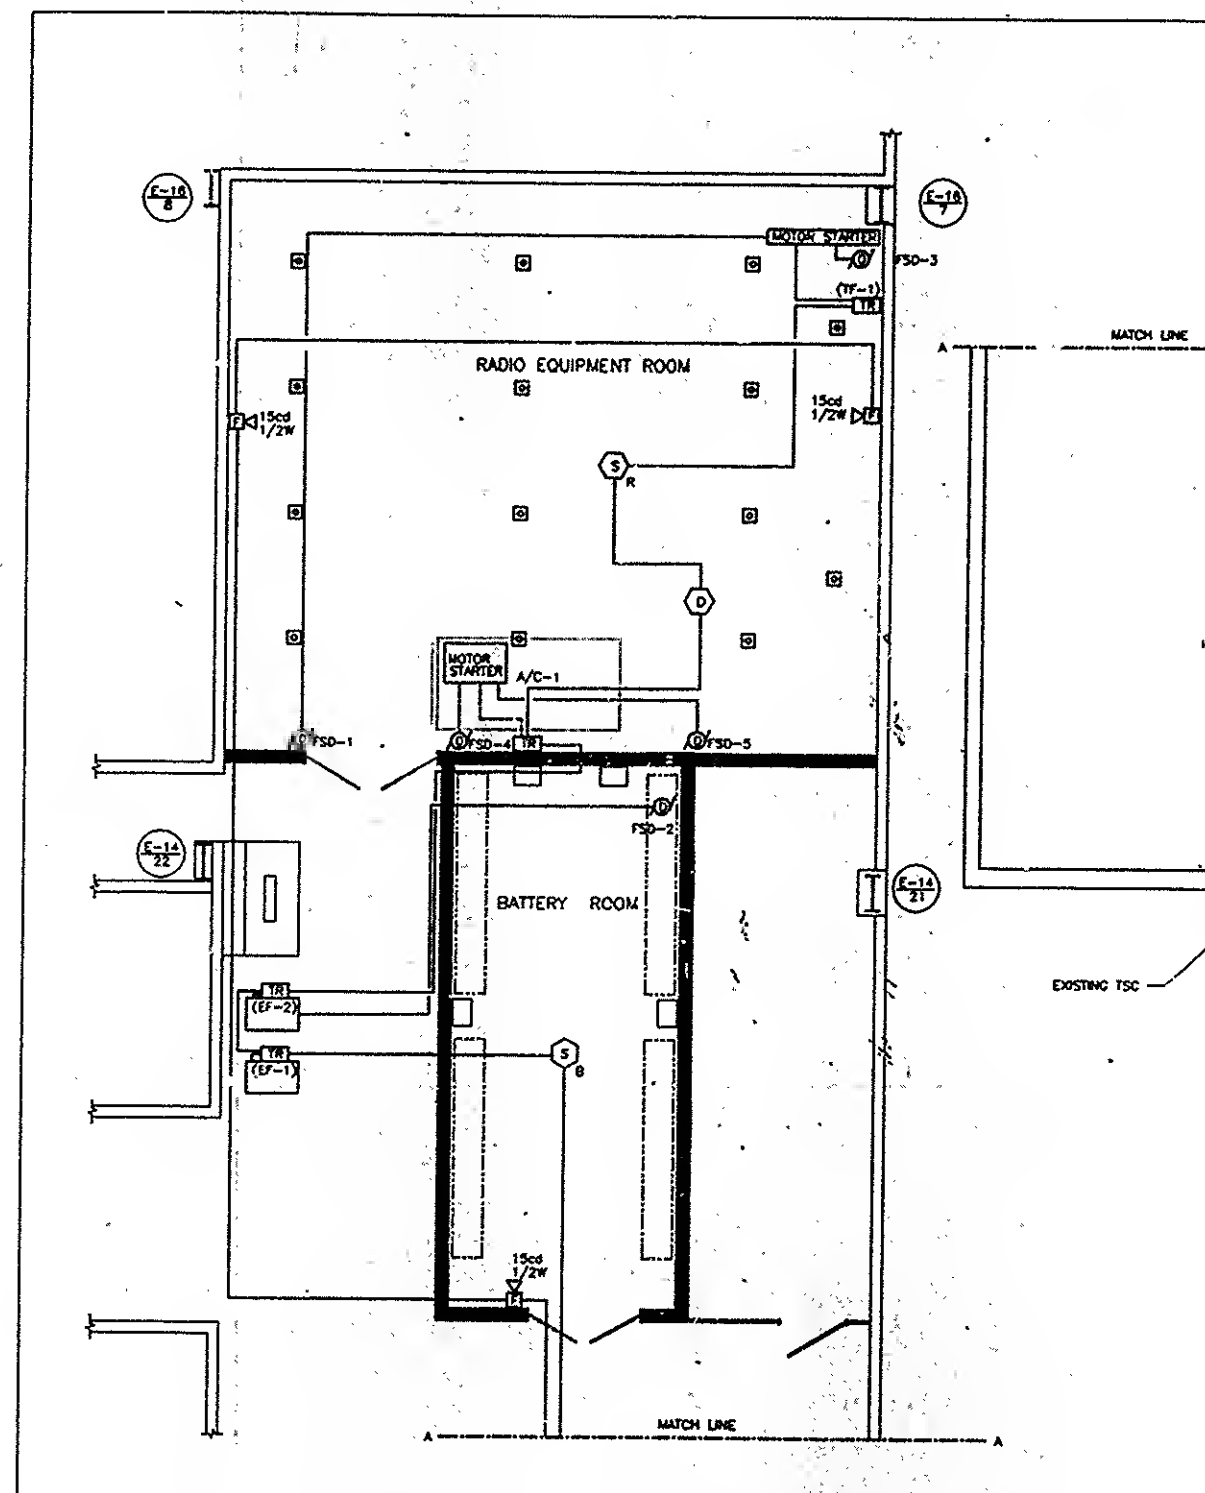

FIRE ALARM SYSTEM

0 2 4 6 8
SCALE IN FEET